

CHBE320 LECTURE III ACTUATOR AND CONTROL VALVE SELECTION

Professor Dae Ryook Yang

Fall 2021


Dept. of Chemical and Biological Engineering
Korea University

CHBE320 Process Dynamics and Control

Korea University 3-1

Road Map of the Lecture III

- Visit Actuator

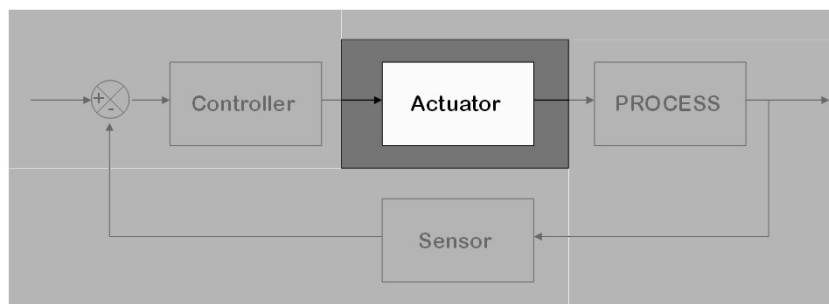

- What is actuator?
- D/A converter, Kinds of Valves
- Valve characteristics
- Selection of control valves

CHBE320 Process Dynamics and Control

Korea University 3-2

INTRODUCTION TO ACTUATOR

- **What is actuator?**

- Actuator converts the command signal from controllers or higher-level components into physical adjustment in adjustable process variable



- **Actuator types**

- Control valve: pneumatic, electric, hydraulic
- Electric heater output: SCR, thyristor
- Pump/Motor speed: inverter
- Displacement: pneumatic, electric, hydraulic

ACTUATOR AND D/A CONVERTER

- **Actuator**



- Convert the industrial standard signal to action such as valve opening, power level, displacement, and etc.
- Standard instrumentation signal levels and signal conversion transmitters are used.
- Actuator power
 - Pneumatic: simple, low cost, fast, low torque, hysteresis
 - Electric: motor and gear box, high torque, slow
 - Hydraulic: high torque, fast, expensive

- **Digital-to-Analog (D/A) converter (+Hold)**

- Digital signal is converted to continuous signal and the signal is hold until the signal is changed
- Specification: hold type, resolution (8bit, 12bit, 16bit)


CONTROL VALVE

- **Valve+Actuator**
 - Valve opening is adjusted by an actuator
- **Pneumatic Control Valve**
 - Usually 3~15psig signal is provided.
 - I/P transmitter converts 4~20mA signal to 3~15psig pneumatic signal via 20psig supply air

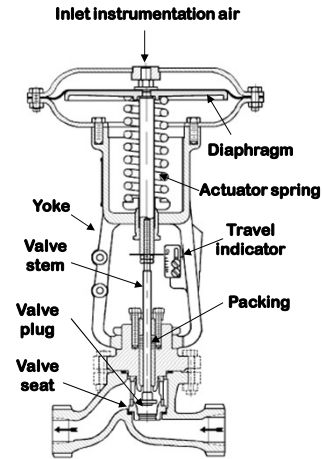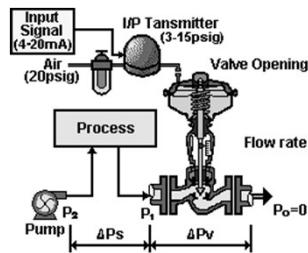


CONTROL VALVE IMPLEMENTATION

- **For the maintenance**
 - Bypass
 - Block valves
- **Installation**
 - Horizontal
 - Vertical
 - Flange type
 - Screw type
 - Reducer may be required

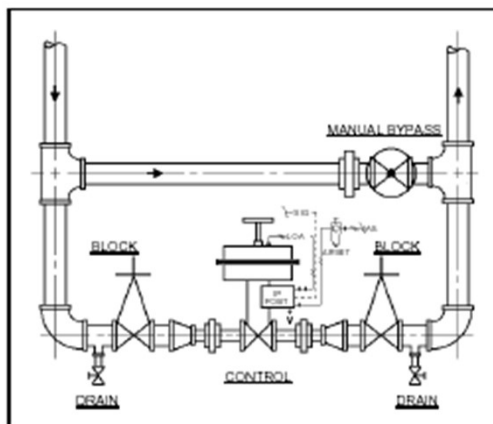

AIR-TO-OPEN OR AIR-TO-CLOSE

- As air pressure increases, the valve opening can becomes larger or smaller
- Air-to-open (normally closed, fail close): as the air P increases, the valve opening gets larger
- Air-to-close (normally open, fail open): as the air P increases, the valve opening gets smaller
- The selection should be made based on the safety consideration
 - Furnace fuel valve should be closed in case of utility failure
 - Coolant valve in exothermic reactor should be open in case of utility failure

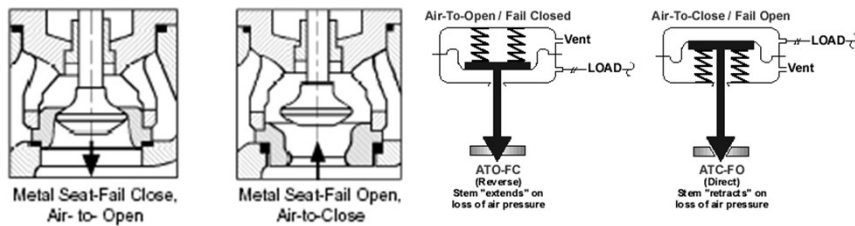


CHBE320 Process Dynamics and Control

Korea University 3-7

CONTROL VALVE PACKING


- Packing is essential to maintain the sealing
- Packing has to be replaced periodically
- Excessive usage may shorten the lifetime of the packing
- Control action should not be too vigorous in order to prevent the excessive wear

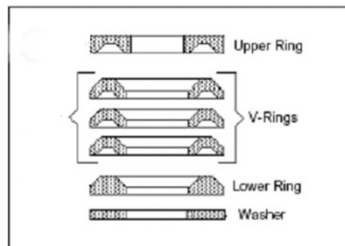

CHBE320 Process Dynamics and Control

Korea University 3-8

CONTROL VALVE CLASSIFICATION

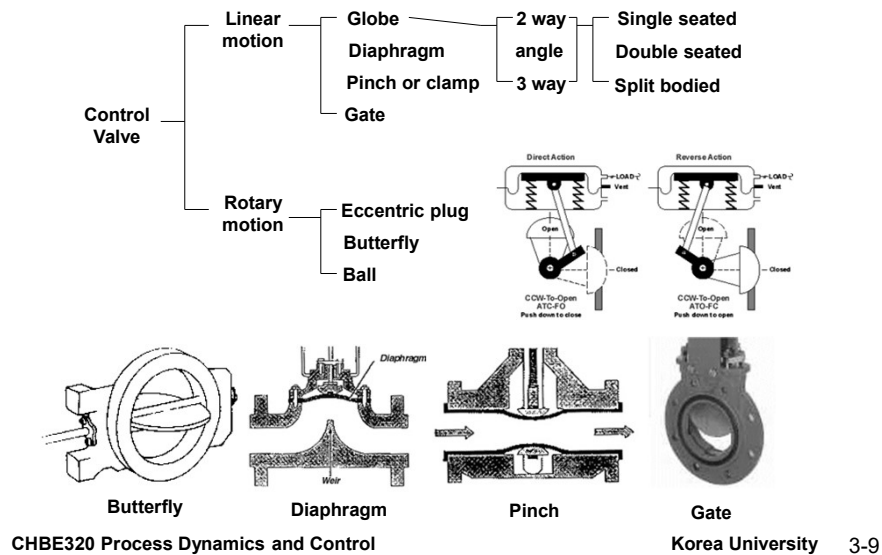

VALVE TYPES

- **Globe valve**
 - rugged, usually the most expensive, particularly in the larger sizes, accurate and repeatable control, high pressure drop
- **Gate Valve**
 - sliding disc (gate), ideal for high pressure and high temperature applications where operation is infrequent, multi-turn or long stroke pneumatic and electro-hydraulic actuators are needed, poor control
- **Ball Valve**
 - tight shutoff, high capacity with just a quarter-turn to operate
- **Butterfly Valve**
 - damper valve , most economical valves, high torque required
- **Diaphragm Valve**
 - simplest, tight shutoff, isolated, ideal for corrosive, slurry and sanitary services.

VALVE EQUATION

- **Basic Equation**


$$q(\ell) = C_v f(\ell) \sqrt{\frac{\Delta P_v}{g_s}} \quad 0 \leq \ell \leq 1$$

where ℓ is the valve stem position.

- Valve coeff. (C_v) is decided by valve size
- Valve trim type for different plug
 - **Linear:** $f(\ell) = \ell$
 - **Square-Root (Quick Opening):** $f(\ell) = \sqrt{\ell}$
 - **Equal Percentage:** $f(\ell) = R^{\ell-1}$
- **R:** rangeability (ratio between minimum flow and maximum flow)
 - ⇒ the bigger R is, the more accurate

VALVE TRIM(PLUG) TYPE

- **Equal Percentage**
 - Most commonly used
 - Used where large pressure drop is expected
- **Linear**
 - Used where fairly constant press. drop is expected
 - Used for liquid level or flow loop
- **Quick Opening**
 - Used for frequently on-off service
 - Used where instantly large flow is needed

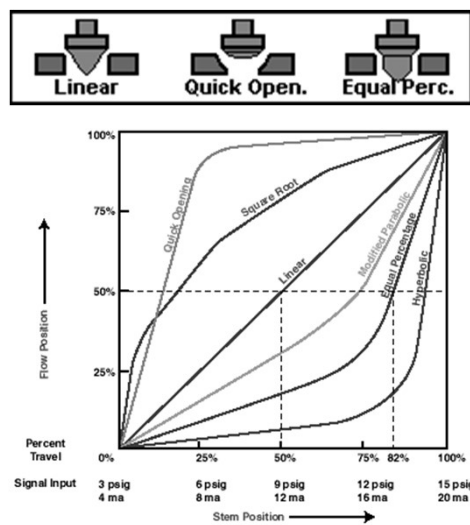


VALVE FLOW CHARACTERISTICS

- **Inherent characteristics**
 - All ΔP is in valve: no ΔP in process
- **Installed characteristics**
 - Total ΔP in a system is provided by a pump or compressor
 - Change in valve opening \Rightarrow flow change in process \Rightarrow change in ΔP across the valve
 - Linear plug does not lead to linear behavior when installed

$$\Delta P_{total} = \Delta P_v + \Delta P_s$$

$$\Delta P_s = kq^2$$

$$\Delta P_{total} = \left(\frac{q_{max}}{C_v}\right)^2 g_s + kq_{max}^2$$

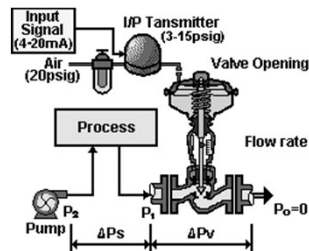

CHBE320 Process Dynamics and Control

Korea University 3-13

NONLINEAR BEHAVIOR

- **Flow vs. valve trim (installed)**

$$q(\ell) = C_v f(\ell) \sqrt{\frac{\Delta P_v}{g_s}} \quad 0 \leq \ell \leq 1$$

where

$$\Delta P_v = \Delta P_{total} - \Delta P_s = \left(\frac{q_{max}}{C_v}\right)^2 g_s + kq_{max}^2 - kq^2$$

\Rightarrow implicit nonlinear equation of flow and valve trim

- **The pumping requirement (ΔP_{total}) is determined by the ΔP in both process and control valve at the max. flow**

CHBE320 Process Dynamics and Control

Korea University 3-14

VALVE SIZING

- **Step1**
 - Decide max. and min. flow of a fluid (rangeability for equal percentage valve) and ΔP_{total} .
- **Step2**
 - Define a max. allowable ΔP_v when the valve is wide open.
 - It should be 10~15% of ΔP_{total} or about 10psi whichever is greater.
- **Step3**
 - Calculate the installed valve characteristic.
 - It should be linear around the region you want.
- **Step4**
 - Adjust the pumping requirement (ΔP_{total}) if possible and valve coeff. (C_v) so that the max. flow can be achieved at about 80-85% opening and the min. flow can be achieved at about 10-15% opening.
 - Make sure that the ΔP_v when the valve is wide open is not over the limit in Step2.
 - Select valve size with suitable C_v value. The valve size should not be smaller than half of pipe size.

CHBE320 Process Dynamics and Control

Korea University 3-15

OTHER CONSIDERTIONS

- **If pump characteristic curve is available**
 - For many pumps, as flow increases, the pump discharge pressure is decreased.
 - Then the pump discharge P (ΔP_{total}) will change with flow rate.
- **Choked flow (flow at sound velocity)**
 - When the ΔP across the valve is large, sonic velocity is attained. A different type of flow equation should be used.
 - When ΔP gets larger, then choked flow occurs, and the downstream pressure does not influence the flow rate.
 - Also, if the ΔP is too high, flashing may occur for liquid flows. (Noisy)
 - Thus, avoid excessive pressure drop.
- **If larger valve is used, there will be less ΔP_v and less pumping requirement (ΔP_{total}) is needed. However, the controllability of the flow is sacrificed. (trade-off)**
- **As a rule of thumb, the ΔP_v should be around 1/3~1/4 of ΔP_{total} at nominal flow rate.**

CHBE320 Process Dynamics and Control

Korea University 3-16

HYSTERESIS AND VALVE POSITIONER

- **Hysteresis**
 - Due to friction between the stem and packing, loose linkage, pressure drop, stiction or etc.
 - When the command signal (pneumatic signal) is going up and down, the flow rate will not be same even though the command signal is same depending on the direction of signal change.
 - Remedy
 - Change the command signal with the same direction by lowering or increasing it momentarily
 - Use valve positioner
- **Valve positioner**
 - The valve positioner is a controller which can synchronize the command signal and its corresponding valve stem position.
 - By use of valve positioner, hysteresis can be overcome.



CHBE320 Process Dynamics and Control

Korea University 3-17

GAS FLOW CONTROL



- Control of gas flow rate
 - Damper
 - Butterfly valve type
 - Louver type
 - » Opposite
 - » Parallel
 - Damper Authority



$$\% \text{ Damper Authority (A)} = \frac{\text{Press. drop (fully open)}}{\text{Press. drop (duct system)}} \times 100$$

Small A: inaccurate flow control
Large A: good flow control, but high press. Drop and energy loss

Opposite Louver A: 8 – 10%
Parallel Louver A: 20 – 25%




CHBE320 Process Dynamics and Control

MOTOR SPEED CONTROL


- **Control of motor**
 - Need to control rpm, position, acceleration, torque, etc.
- **DC Motor**
 - The rpm changes continuously depending on the voltage imposed.
 - High price and larger size for power than AC motor
 - Need a converter from AC to DC
- **AC Motor**
 - Low price and low maintenance cost
 - Small size for power and reliable
 - Hard to control the motor speed accurately and lower performance at low speed than DC motor
 - Widely used for the cases where accurate speed control is not required such as fan, pump, compressor and etc.
 - Recent development of electronics and control technique, the control performance is approaching to that of DC motor and the usage of AC motor will be extended.
 - To control the speed of AC motor, the inverter is widely used.

- **Principle of inverter**
 - For pumps, AC induction motor is commonly used.
 - The speed of induction motor depends on the frequency of AC power.
 - 2-pole 60Hz induction motor: 1760rpm
 - 4-pole 60Hz induction motor: 3560rpm
 - Inverter: Electrical device which can alter the frequency of AC power based on digital circuit technology.
 - Pulse Width Modulation (PWM)

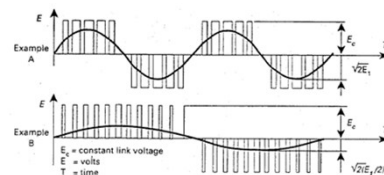

- **Traditional flow control by blower**
 - At constant speed of fan motor, adjust the opening of damper or louver to control the flow rate
 - Fan motor is designed commonly oversized by 10-15%
 - The sizing of damper/louver for operating condition is important to control the flow rate precisely.
 - Through the pressure loss, the flow rate is controlled. (35-50% energy loss)
- **Blower flow control using Inverter**
 - The speed of fan motor is adjusted freely using inverter
 - Pressure loss is maintained almost constant
 - Less energy is required at low flow rate (low motor speed): 50-60% energy saving compared to pressure loss
 - Instead of damper/louver, inverters need to be installed
 - Requires shut-off valve if seal is needed at zero flow rate

- **Example of energy saving**
 - 2400 gpm@3560rpm
 - Pump: 550hp, 77.5% efficiency
 - Flow rates: 2400(A)→1200(B)gpm
 - For constant speed pump
 - using control valve (friction loss)
 - 400hp, 62% efficiency
 - For variable speed pump
 - 70hp, 78% efficiency
 - Comparisons
 - Variable speed pump is more energy efficient
 - Pump sized can be reduced by 330hp
 - Almost no loss in pump efficiency

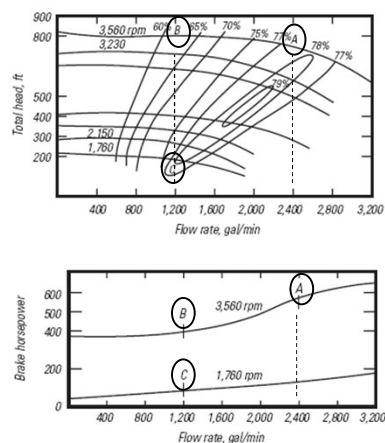

- **Calculation of energy saving**

- **200hp constant speed pump: at normal operating flow condition, 185hp (efficiency=0.92)**
 - Cost of electricity: \$0.035/Kwh
 - Operation pattern: 100% load (15%), 87.5% load (65%), 50% load (15%) → total 95% turned-on
 - Annual operating time: 8760 hr
 - Annual cost: $0.742(\text{Kw/hp}) * 185\text{hp} / 0.92 * \$0.035 * 8760 * 0.95 = \$43,693$
- **Variable speed pump**
 - $F = (\text{frictional head}) / (\text{total head})$ and assume $F = 75 / (75 + 25) = 0.75$.
 - Pressure drop ratio for valve: 75%F
 - Saving: $(0.15 * 16\%) + (0.65 * 31\%) + (0.15 * 69\%) = 32.9\%$
 - Money saving: $\$43,693 * 0.329 = \$14,375$

<Energy savings chart of variable speed pump>

Rated flow, %	System type				
	100%F	75%F	50%F	25%F	
100	21	16	9	3	
87.5	38	31	20	12	
75	57	47	35	20	
50	81	69	55	41	

Source: Hydrocarbon Proc., September 1979

- **Other advantages**
 - Low noise
 - Long life of pump by soft startup